

# NORX WINDLOAD TEST REPORT

**SCOPE OF WORK**

ASTM D5206 WINDLOAD TESTING PER ICC-ES AC524 SECTION 3.8 ON NEW YORK COLLECTION, HORIZONTAL CLADDING

**REPORT NUMBER**

P0941.05-109-40

**TEST DATES**

12/21/23 - 12/22/23

**ISSUE DATE**

02/12/24

**RECORD RETENTION END DATE**


12/22/27

**PAGES**

8

**DOCUMENT CONTROL NUMBER**

ATI 00500 (01/18/24)  
RT-R-AMER-Test-2808  
© 2017 INTERTEK

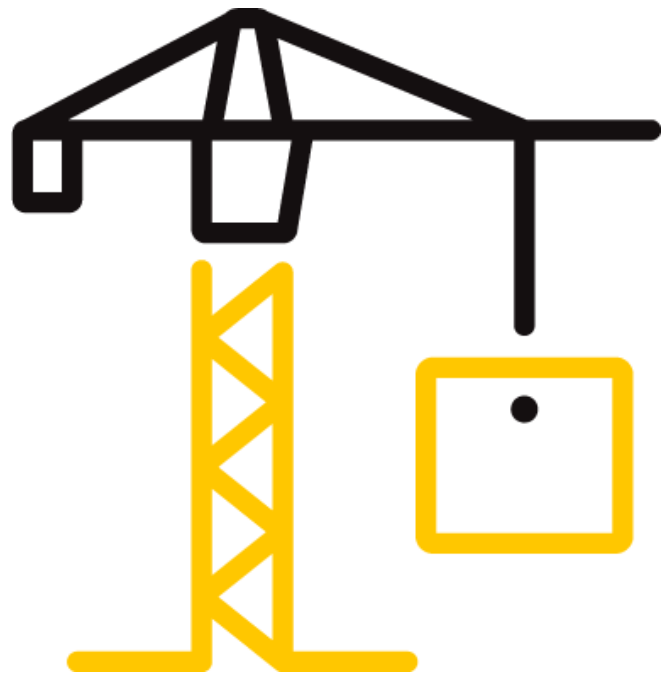

## TEST REPORT FOR NORX

Report No.: P0941.05-109-40

Date: 02/12/24

### REPORT ISSUED TO

#### NORX

20807 Biscayne Blvd. Unit 304

Aventura, Florida 33180

### SECTION 1

#### SCOPE

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by Norx to perform windload testing in accordance with ASTM D5206 per ICC-ES AC524 Section 3.8 on their New York Collection, horizontal cladding. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at Intertek B&C test facility in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Intertek B&C will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained for the entire test record retention period.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk Approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

For INTERTEK B&C:

<b>COMPLETED BY:</b>	Austin G. Beck
<b>TITLE:</b>	Technician – Product Testing
<b>SIGNATURE:</b>	
<b>DATE:</b>	02/12/24

<b>REVIEWED BY:</b>	Ken R. Stough
<b>TITLE:</b>	Project Manager – Product Testing
<b>SIGNATURE:</b>	
<b>DATE:</b>	02/12/24

AGB:mas

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

## TEST REPORT FOR NORX

Report No.: P0941.05-109-40

Date: 02/12/24

### SECTION 2

#### TEST METHODS

The specimens were evaluated in accordance with the following:

**ASTM D5206-19**, *Standard Test Method for Windload Resistance of Rigid Plastic Siding*

**ICC-ES AC524 Section 3.8**, *Acceptance Criteria for Wood-Plastic Composite Products used as Exterior Siding*

### SECTION 3

#### MATERIAL SOURCE/INSTALLATION

The specimen(s) were selected by Intertek B&C personnel. The specimen(s) was/were witnessed during production and tagged prior to shipment on 02/13/23 - 02/14/23, (Reference Intertek B&C Test Specimen Selection Report No. P0941.01-119-19 dated 02/13/23 - 02/14/23).

The specimen was installed into test buck measuring 4' 1-1/2" wide by 6' high constructed of #2 Spruce-Pine-Fir nominal 2x4 lumber. Two studs were spaced 16" on center (three spans) and were attached to the top and bottom plates with 3" long drywall screws. A sheet of nominal 7/16" thick OSB, with five 4" diameter holes to allow pressure to transfer to the siding, was secured to the studs with #8 x 1-5/8" drywall screws. Spruce-Pine-Fir furring strips measuring 1-1/2" x 1-1/2" were secured to the wall vertically, located 16" on center (three spans) with 3" long drywall screws. Silicone was utilized on the backside of the test panel to seal the perimeter. A 2-mil thick plastic film was loosely draped over the interior and exterior of the siding to enable attainment of negative and positive pressure.

The first course of cladding was mounted to the furring strips with a 1" wide, 1/16" thick U-shaped starter clip (CLAD-SSS7). A 5/32" drill bit was used to pre drill holes 16" on center to allow 1/8" diameter, 7/32" head, 1-1/2" long trim screws (CLAD-SSC1) to fasten the cladding to the furring strips.

### SECTION 4

#### EQUIPMENT

**Tape measure:** 63788

**Control Panel:** 003921

**Weather Station:** 63316

## TEST REPORT FOR NORX

Report No.: P0941.05-109-40

Date: 02/12/24

### SECTION 5

#### LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Jason R. Zeller	Intertek B&C
Ken R. Stough	Intertek B&C
Austin G. Beck	Intertek B&C

### SECTION 6

#### TEST SPECIMEN DESCRIPTION

MANUFACTURER	Norx
SERIES/MODEL	New York Collection
PRODUCT TYPE	Horizontal cladding
MATERIAL TYPE	Composite
NOMINAL THICKNESS	0.291"
MEASURED THICKNESS	0.297"
NAIL HEM TYPE	Single
NAIL HEM THICKNESS	0.465"
NAIL SLOT EDGE DISTANCE	0.400"
EXTERIOR FINISH	Wood grain finish

Each specimen consisted of five horizontal courses of siding with a female interlock on the bottom and a male interlock on the top.

### SECTION 7

#### TEST RESULTS

The temperature during testing was 21-23°C (70-73°F). The results are tabulated as follows:

**General Note:** All loads were negative pressure and were held for thirty seconds. A 5.0 psf pre-load was applied before running specimens to failure.

#### Test Specimen #1:

PRESSURE	RESULTS
10.0 psf to 200.0 psf	No damage
205.0 psf	Nail hem over-rode the installation fasteners at the 5th course.

## TEST REPORT FOR NORX

Report No.: P0941.05-109-40

Date: 02/12/24

### Test Specimen #2:

PRESSURE	RESULTS
10.0 psf to 195.0 psf	No damage
200.0 psf	Nail hem over-rode the installation fasteners at the 5th course.

### Test Specimen #3:

PRESSURE	RESULTS
10.0 psf to 195.0 psf	No damage
200.0 psf	Nail hem over-rode the installation fasteners at the 5th course.

**General Note:** All loads were Positive pressure and were held for thirty seconds. A 5.0 psf pre-load was applied before running specimens to failure.

### Test Specimen #4:

PRESSURE	RESULTS
10.0 psf to 200.0 psf	No damage
200.0 psf	Exceeded the buck limitations

### Test Specimen #5:

PRESSURE	RESULTS
10.0 psf to 200.0 psf	No damage
200.0 psf	Exceeded the buck limitations

### Test Specimen #6:

PRESSURE	RESULTS
10.0 psf to 200.0 psf	No damage
200.0 psf	Exceeded the buck limitations

## SECTION 8

### CONCLUSION

The specimens #1-3 tested successfully achieved an Average Maximum Sustained Negative Pressure of 196.7 psf and an Average Ultimate Negative Test Pressure of 201.7 psf.

The specimens #4-6 tested successfully achieved an Average Maximum Sustained Positive Pressure of 200.0 psf and an Average Ultimate Positive Test Pressure of 200.0 psf.

**TEST REPORT FOR NORX**  
Report No.: P0941.05-109-40  
Date: 02/12/24

## SECTION 9 PHOTOGRAPHS



**Photo No. 1**  
**Test Specimen #1 New York Collection, Cladding**

## SECTION 10 DRAWING


The test specimen drawings have been reviewed by Intertek B&C and are representative of the test specimen(s) reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.




# New York Square

## SPEC SHEET

ISOMETRIC VIEW



ACTUAL SIZE

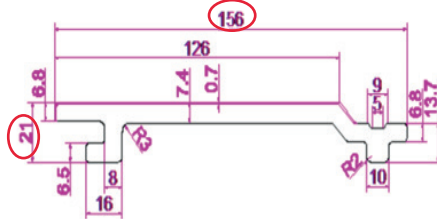

MEASURES  
(mm / in)

- 156mm (= 6.14in)
- 126mm (= 4.96in)
- 21mm (= 0.82in)
- 16mm (= 0.62in)
- 13.7mm (= 0.53in)
- 10mm (= 0.4in)
- 9mm (= 0.35in)
- 8mm (= 0.31in)
- 7.4mm (= 0.3in)
- 6.8mm (= 0.26in)
- 6.5mm (= 0.25in)
- 0.7mm (= 0.02in)

### TECHNICAL DETAILS

<b>DENSITY</b>	1.3g/m <sup>3</sup> (Standard: ASTM D792-13 Method B)
<b>TENSILE STRENGTH</b>	24.9 MPa (Standard: ASTM D638-14)
<b>FLEXURAL STRENGTH</b>	34.5Mp (Standard: ASTM D790-10)
<b>FLEXURAL MODULUS</b>	3510Mpa (Standard: ASTM D790-10)
<b>IMPACT STRENGTH</b>	88J/m (Standard: ASTM D4812-11)
<b>SHORE HARDNESS</b>	D70 (Standard: ASTM D2240-05)
<b>WATER ABSORPTION</b>	0.63% (Standard: ASTM D570-98)
<b>THERMAL EXPANSION</b>	33.12 x10 <sup>-6</sup> (Standard: ASTM D696 - 08)
<b>SLIP RESISTANT</b>	R11 (Standard: DIN 51130:2014)

**DIMENSIONS** 21mm x 156 mm x 487cm (1 in x 6 in x 16ft)

**COLOURS** Brooklyn  
Empire State

	Report #: <u>P0941.05</u>
	Date: <u>2/5/24</u>
	Verified by: <u>Quinton St. Burk</u>

#### INSPECTION CRITERIA

- |   |   |
|---|---|
| <p><b>1. Visual Check</b></p> <ul style="list-style-type: none"> <li>1.1 Type of profile</li> <li>1.2 Surface</li> <li>1.3 Color</li> <li>1.4 Sanding Structure</li> <li>1.5 Crosscut &amp; Lengthcut</li> <li>1.6 Core Visual</li> </ul> | <p><b>2. Dimension Check</b></p> <ul style="list-style-type: none"> <li>2.1 Control section and length</li> </ul> <p><b>3. Measure</b></p> <ul style="list-style-type: none"> <li>3.1 Weight</li> <li>3.2 Density</li> <li>3.3 Mechanical strength</li> </ul> |
|---|---|



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

**TEST REPORT FOR NORX**  
Report No.: P0941.05-109-40  
Date: 02/12/24

**SECTION 11**  
**REVISION LOG**

REVISION #	DATE	PAGES	REVISION
0	02/12/24	N/A	Original Report Issue